


Type-13

Power Cabling and Gas Pipes

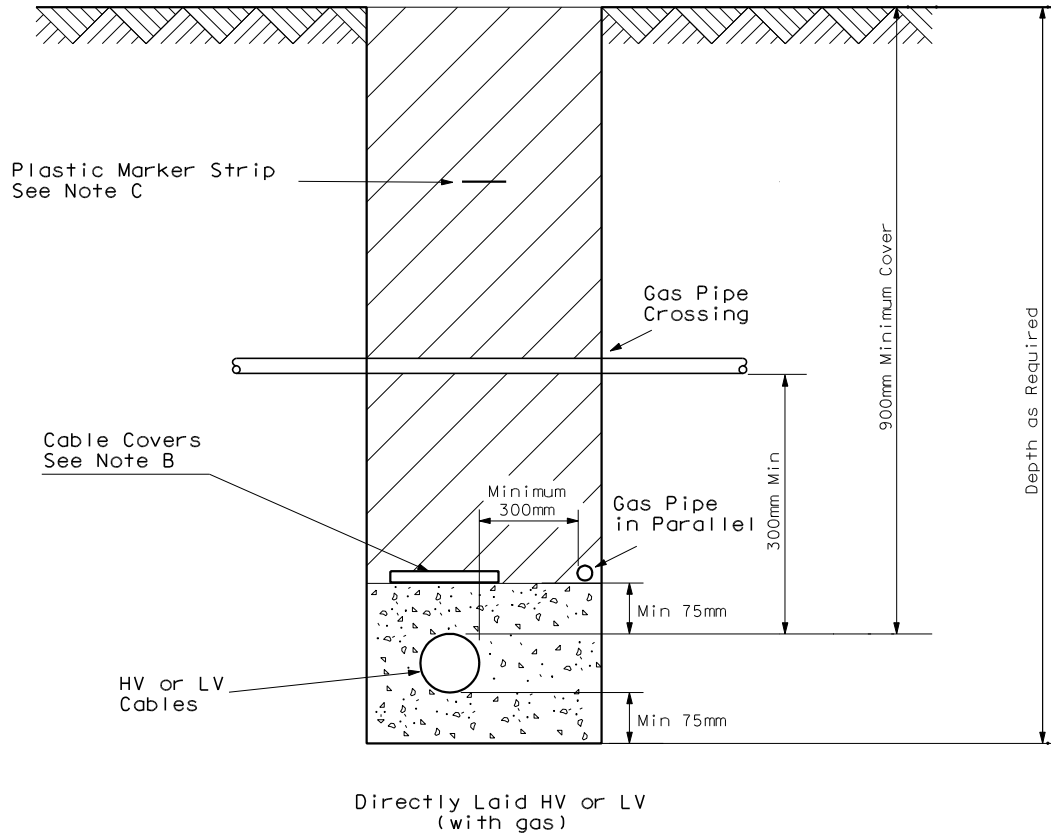

NOTES:

- Diagram shows directly buried power cables. The minimum gas separation is the same for ducted cables.
- Covers to comply with AS/NZS 3000:2007 3.11.3 and 3.11.4 and AS4702-2000 and shall be located 75mm above cables and ducts. Cable covers shall be at least 150mm in width and overlap at least 40mm each side of the cable.
- Marker strip it comply with AS/NZS 3000:2007 3.11.4.5 and be 100mm wide, coloured orange, with words 'Electrical Cable Below'.

Rev	Amendments	By	Checked	Date
B	Add Type-13 to plan	CP	S.L.	16/12/05
C	Updated Standards	CP	R.W.	10/04/13

Title	
General Diagram for Power and Gas	
Scale NTS	Sheet size A4

Drawn	C. Parkes	Date	20/10/05
Checked	R. Watson	Date	9/12/05
Approved	S. Lowe	Date	9/12/05
Issue	C	Date	11/04/13
Plan Number		2F250s13	