


Type-7

Power Cabling Only

Telecom not Included

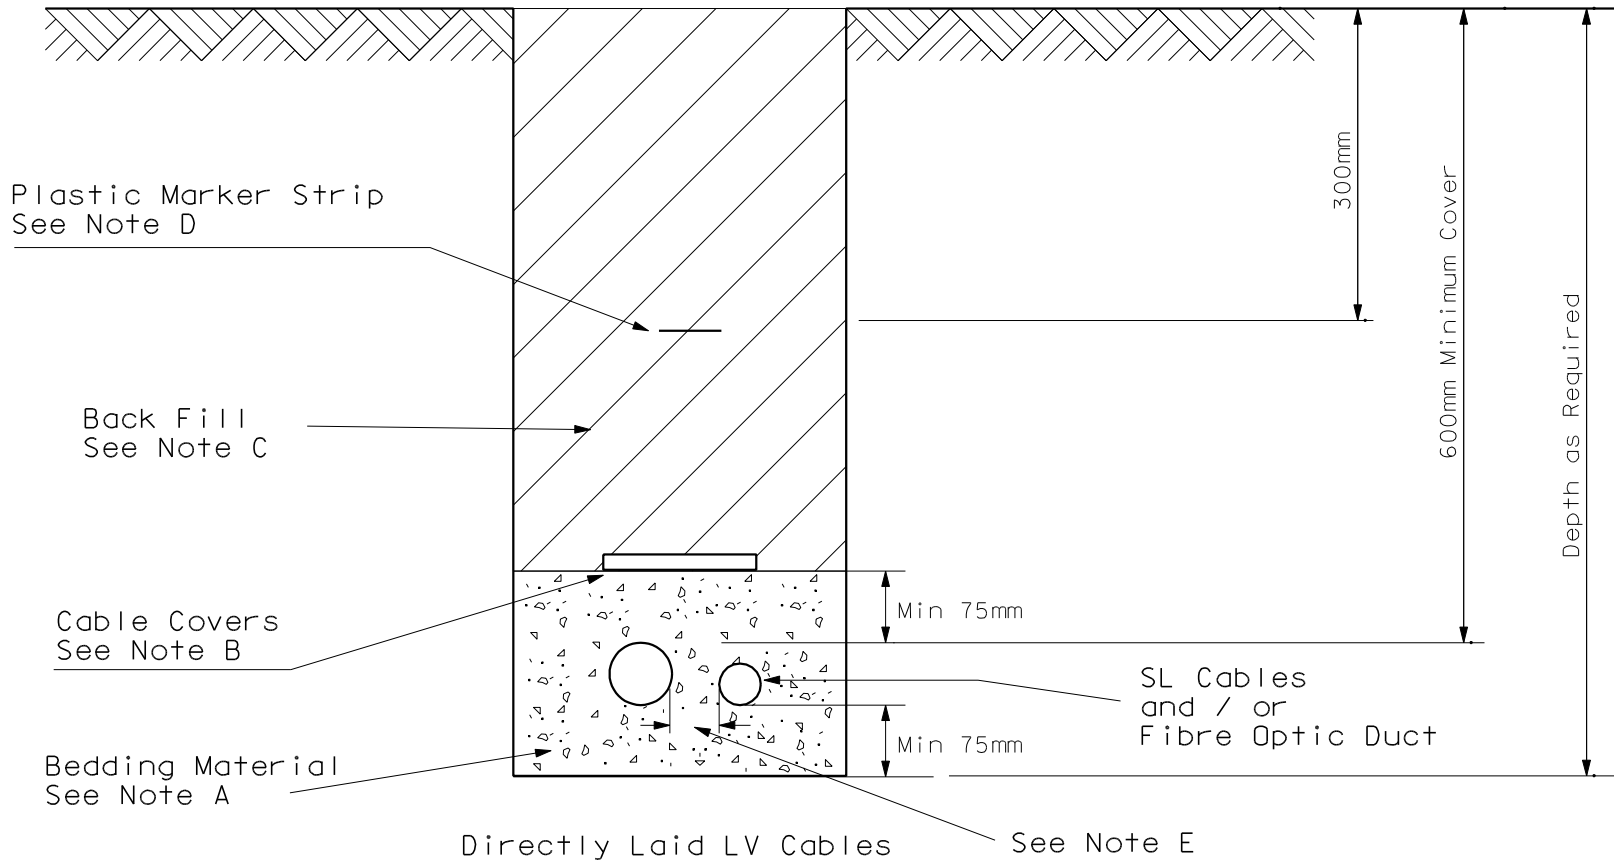

NOTES:

- A. Bedding material either sand or 'clean' soil. Thermal backfill to be used where specified
- B. Covers to comply with AS/NZS 3000:2007 3.11.3 and 3.11.4 and AS4702-2000 and shall be located 75mm above cables and ducts. Cable covers shall be at least 150mm in width and overlap at least 40mm each side of the cable.
- C. Back Fill, generally use fill from trench but ensure no large stones or sharp objects are placed back in the trench.
- D. Marker strip to comply with AS/NZS 3000:2007 3.11.4.5 and be 100mm wide, coloured orange, with words 'Electrical Cable Below'.
- E. Where practical provide some separation (75mm or greater) between direct laid LV and SL cable / fibre optic duct.

| | | | | | | | | | | |
|--|-----|--------------------|----|---------|----------|---|----------|-------------|---------|----------|
| <small>Head Office 28 Mt Pleasant Road Private Bag 9018</small> <small>M.R. Gatland BE MIPENZ Chief Executive</small> <small>Telephone 0-9-430 1803 Facsimile 0-9-430 1804 http://www.northpower.co.nz</small> | Rev | Amendments | By | Checked | Date | Directly Laid LV Cables Scale NTS Sheet size A4 | Drawn | C. Parkes | Date | 20/10/05 |
| | B | Add Type-7 to plan | CP | S.L. | 16/12/05 | | Checked | R. Watson | Date | 9/12/05 |
| | C | Add Note E | CP | R.W. | 10/07/08 | | Approved | S. Lowe | Date | 9/12/05 |
| | D | Update Standards | CP | R.W. | 10/04/13 | | Issue | D | Date | 11/04/13 |
| | | | | | | | | Plan Number | 2F250s7 | |