


# Type-1

Power Cabling Only

Telecom not Included

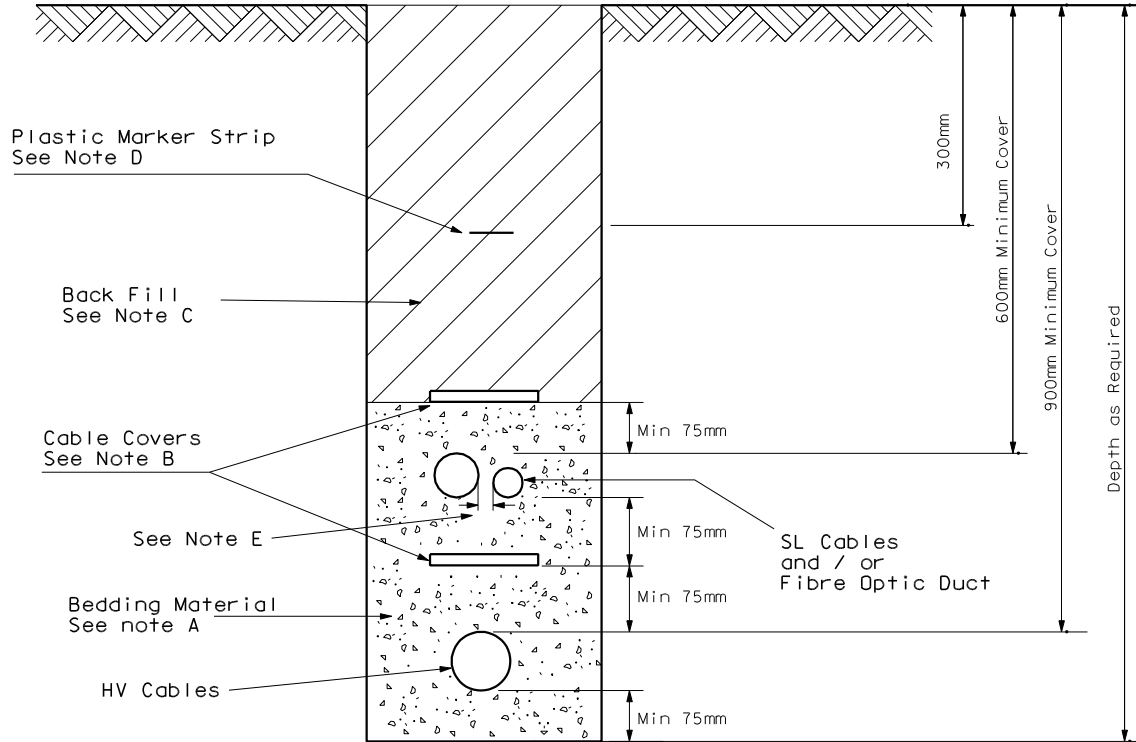

Directly Laid HV & LV Cables  
(or Spare Duct)

## NOTES:

- A. Bedding material either sand or 'clean' soil. Thermal backfill to be used where specified
- B. Covers to comply with AS/NZS 3000:2007 3.11.3 and 3.11.4 and AS4702-2000 and shall be located 75mm above cables and ducts. Cable covers shall be at least 150mm in width and overlap at least 40mm each side of the cable. (except in the case of duct).
- C. Back Fill, generally use fill from trench but ensure no large stones or sharp objects are placed back in the trench.
- D. Marker strip to comply with AS/NZS 3000:2007 3.11.4.5 and be 100mm wide, coloured orange, with words 'Electrical Cable Below'.
- E. Where practical provide some separation (75mm or greater) between direct laid LV and SL cable / fibre optic duct.

Rev	Amendments	By	Checked	Date	Title
B	Add Type-1 to plan	CP	S.L.	16/12/05	Directly Laid HV & LV Cables (or Spare Duct)
C	Add Note E	CP	R.W.	10/07/08	
D	Updated Standards	CP	R.W.	10/04/13	

Drawn	C. Parkes	Date	20/10/05
Checked	R. Watson	Date	9/12/05
Approved	S. Lowe	Date	9/12/05
Issue	D	Date	11/04/13
Plan Number			
Scale NTS		Sheet size A4	