


Type-10

Power Cabling and Telecom

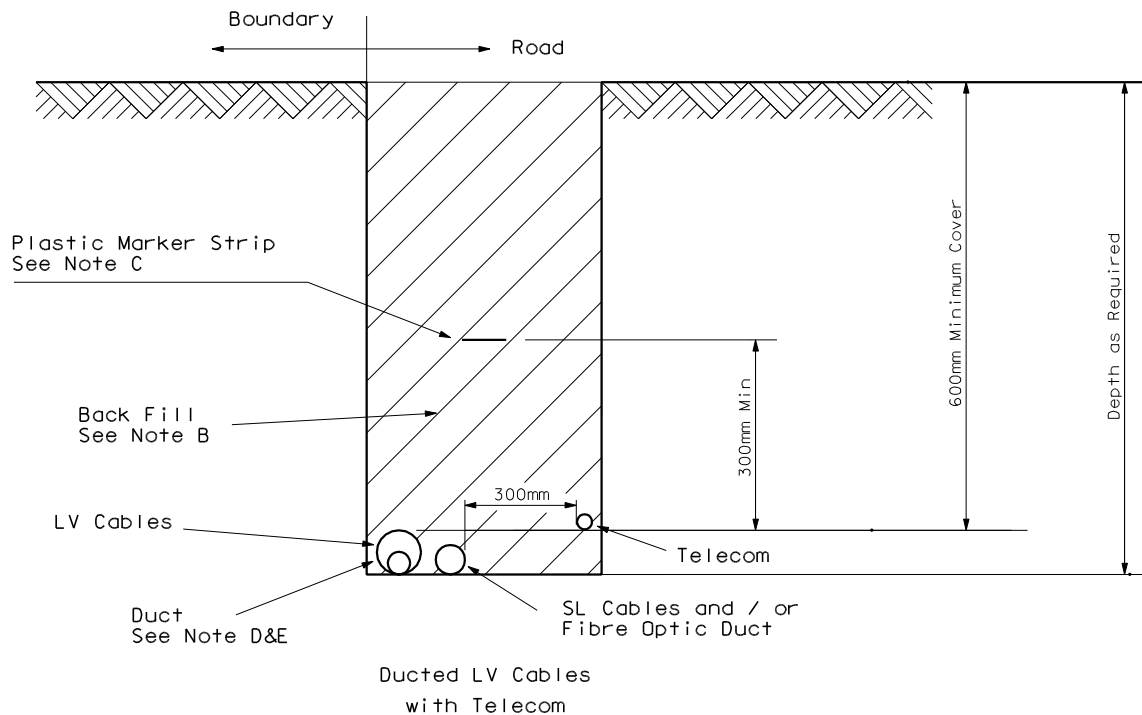

NOTES:

- A. Ducted cables may be laid on the base of the trench. However, in rock areas of where the base of the trench is unsuitable for cable laying, 50mm of sand or stone free soil shall be laid in the base of the trench.
- B. Back Fill, generally use fill from trench but ensure no large stones or sharp objects are place back in the trench
- C. Marker strip it comply with AS/NZS 3000:2007 3.11.4.5 and be 100mm wide, coloured orange, with words 'Electrical Cable Below'.
- D. No right angle bends should be installed in duct lines, bending radius in duct should be no less than the minimum specified by cable manufacturer.
- E. Duct is to comply with AS/NZS 3000:2007. If heavy duty duct is not used additional mechanical protection may be required for some types of cables. See drawing 2F250s8 for details regarding additional mechanical protection.