


Type-11

Power Cabling Only. Telecom not Included

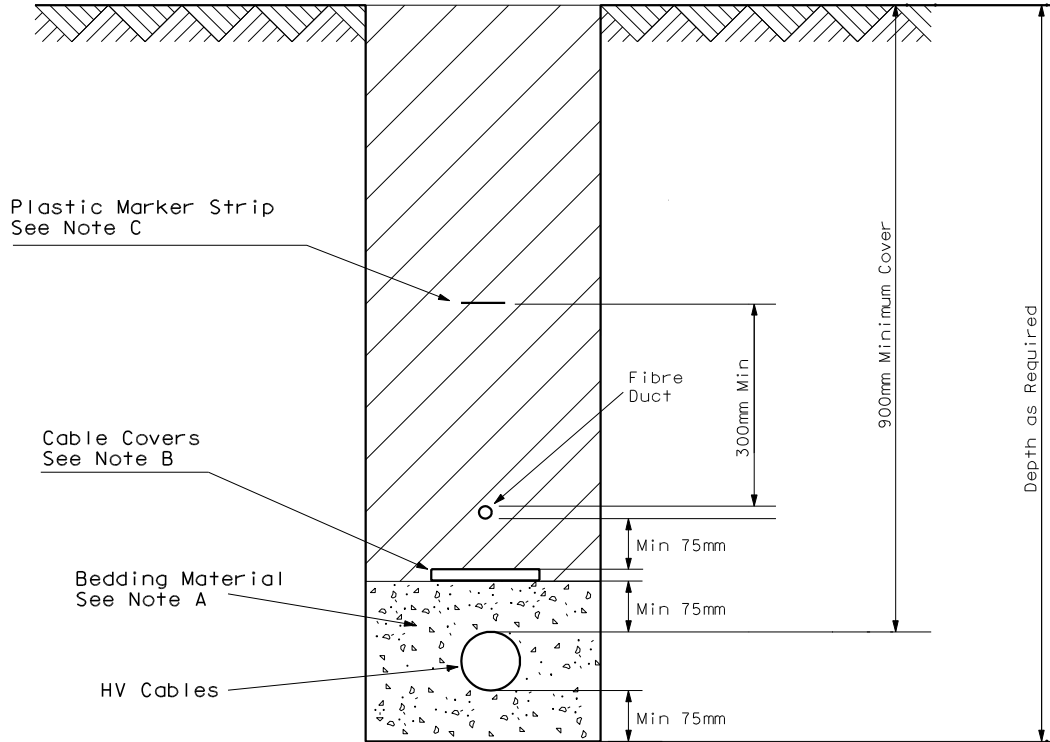

Directly Laid HV

NOTES:

- A. Bedding material either sand or 'clean' soil. Thermal backfill to be used where specified
- B. Covers to comply with AS/NZS 3000:2007 3.11.3 and 3.11.4 and AS4702-2000 and shall be located 75mm above cables and ducts. Cable covers shall be at least 150mm in width and overlap at least 40mm each side of the cable.
- C. Marker strip to comply with AS/NZS 3000:2007 3.11.4.5 and be 100mm wide, coloured orange, with words 'Electrical Cable Below'.

 Head Office 28 Mt Pleasant Road Private Bag 9018 Telephone 0-9-430 1803 Facsimile 0-9-430 1804 http://www.northpower.co.nz	Rev	Amendments	By	Checked	Date	Directly Laid HV Scale NTS Sheet size A4	Drawn	C. Parkes	Date	20/10/05
	B	Add Type-11 to plan	CP	S.L.	16/12/05		Checked	R. Watson	Date	9/12/05
	C	Add Fibre Duct	CP	R.W.	10/07/08		Approved	S. Lowe	Date	9/12/05
	D	Update Standards	CP	R.W.	10/04/13		Issue	D	Date	11/04/13
							Plan Number	2F250s11		