


Type-14

Power Cabling and Telecom (Alternative Option)

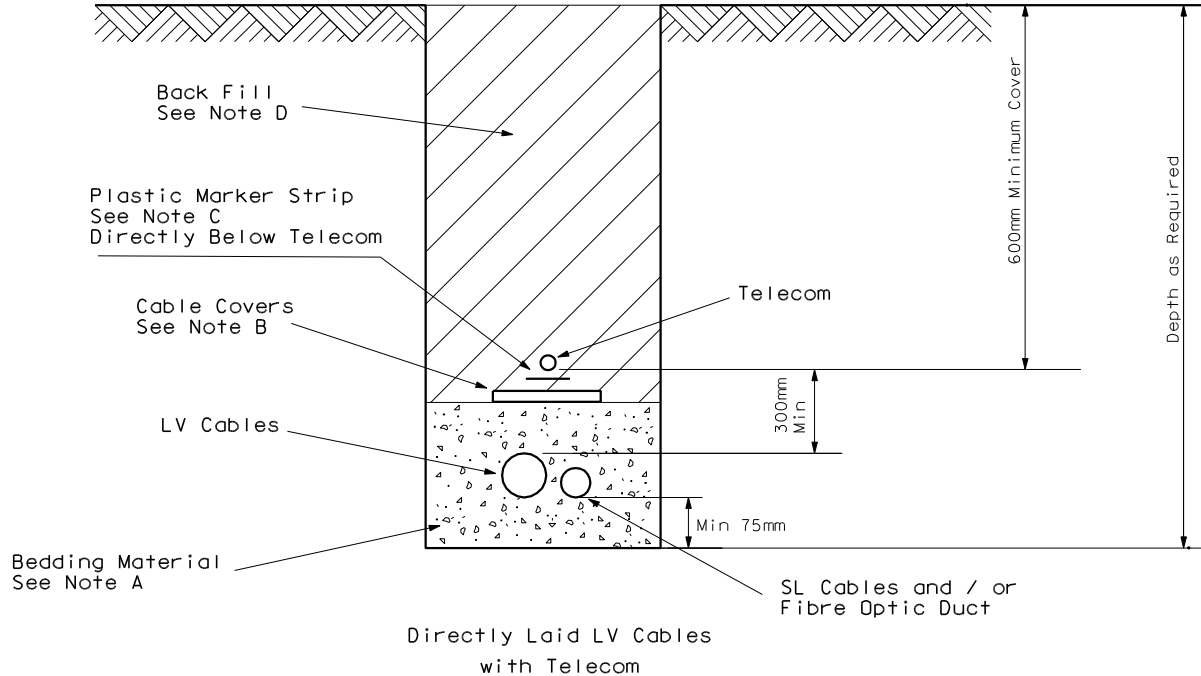

NOTES:

- A. Bedding material either sand or 'clean' soil. Thermal backfill to be used where specified
- B. Covers to comply with AS/NZS 3000:2007 3.11.3 & 3.11.4 and AS4702-2000 and shall be located 75mm above cables and ducts. Cable covers shall be at least 150mm in width and overlap at least 40mm each side of the cable.
- C. Marker strip it comply with AS/NZS 3000:2007 3.11.4.5 and be 100mm wide, coloured orange, with words 'Electrical Cable Below'.
- D. Back fill, generally use fill from trench but ensure no large stones or sharp objects are placed back in the trench.
- E. See Plan 2F250s8 for preferred option

Rev	Amendments	By	Checked	Date	Title
B	Add Type-14 to plan	CP	S.L.	16/12/05	Directly Laid LV Cables with Telecom (Alternative Option)
C	Update Standards	CP	R.W.	10/04/13	

Drawn	C. Parkes	Date	20/10/05
Checked	R. Watson	Date	12/12/05
Approved	S. Lowe	Date	12/12/05
Issue	C	Date	11/04/13
Plan Number			
2F250s14			