


# Type-16

## Power Cabling and Telecom (Alternative Option)

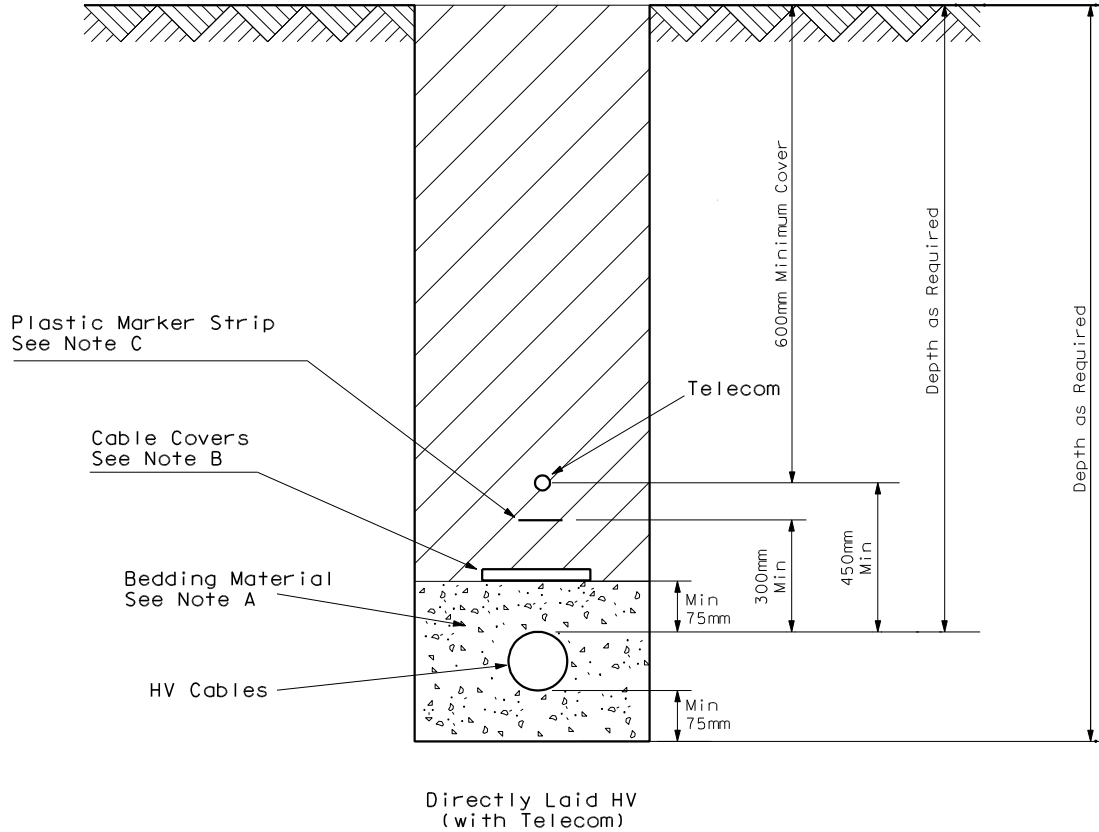

### NOTES:

- A. Bedding material either sand or 'clean' soil. Thermal backfill to be used where specified
- B. Covers to comply with AS/NZS 3000:2007 3.11.3 and 3.11.4 and AS4702-2000 and shall be located 75mm above cables and ducts. Cable covers shall be at least 150mm in width and overlap at least 40mm each side of the cable.
- C. Marker strip it comply with AS/NZS 3000:2007 3.11.4.5 and be 100mm wide, coloured orange, with words 'Electrical Cable Below'.
- D. See Plan 2F250s5 for preferred option.

| Rev | Amendments          | By | Checked | Date     |
|-----|---------------------|----|---------|----------|
| B   | Add Type-16 to plan | CP | S.L.    | 16/12/05 |
| C   | Update Standards    | CP | R.W.    | 10/04/13 |

| Rev | Checked   | Date     |
|-----|-----------|----------|
| B   | R. Watson | 12/12/05 |
| C   | S. Lowe   | 12/12/05 |
| D   | C         | 11/04/13 |

Scale NTS Sheet size A4

| Drawn    | C. Parkes | Date | 20/10/05 |
|----------|-----------|------|----------|
| Checked  | R. Watson | Date | 12/12/05 |
| Approved | S. Lowe   | Date | 12/12/05 |
| Issue    | C         | Date | 11/04/13 |

Plan Number **2F250s16**