


Standard Temporary Builders Supply Diagram Plan 13

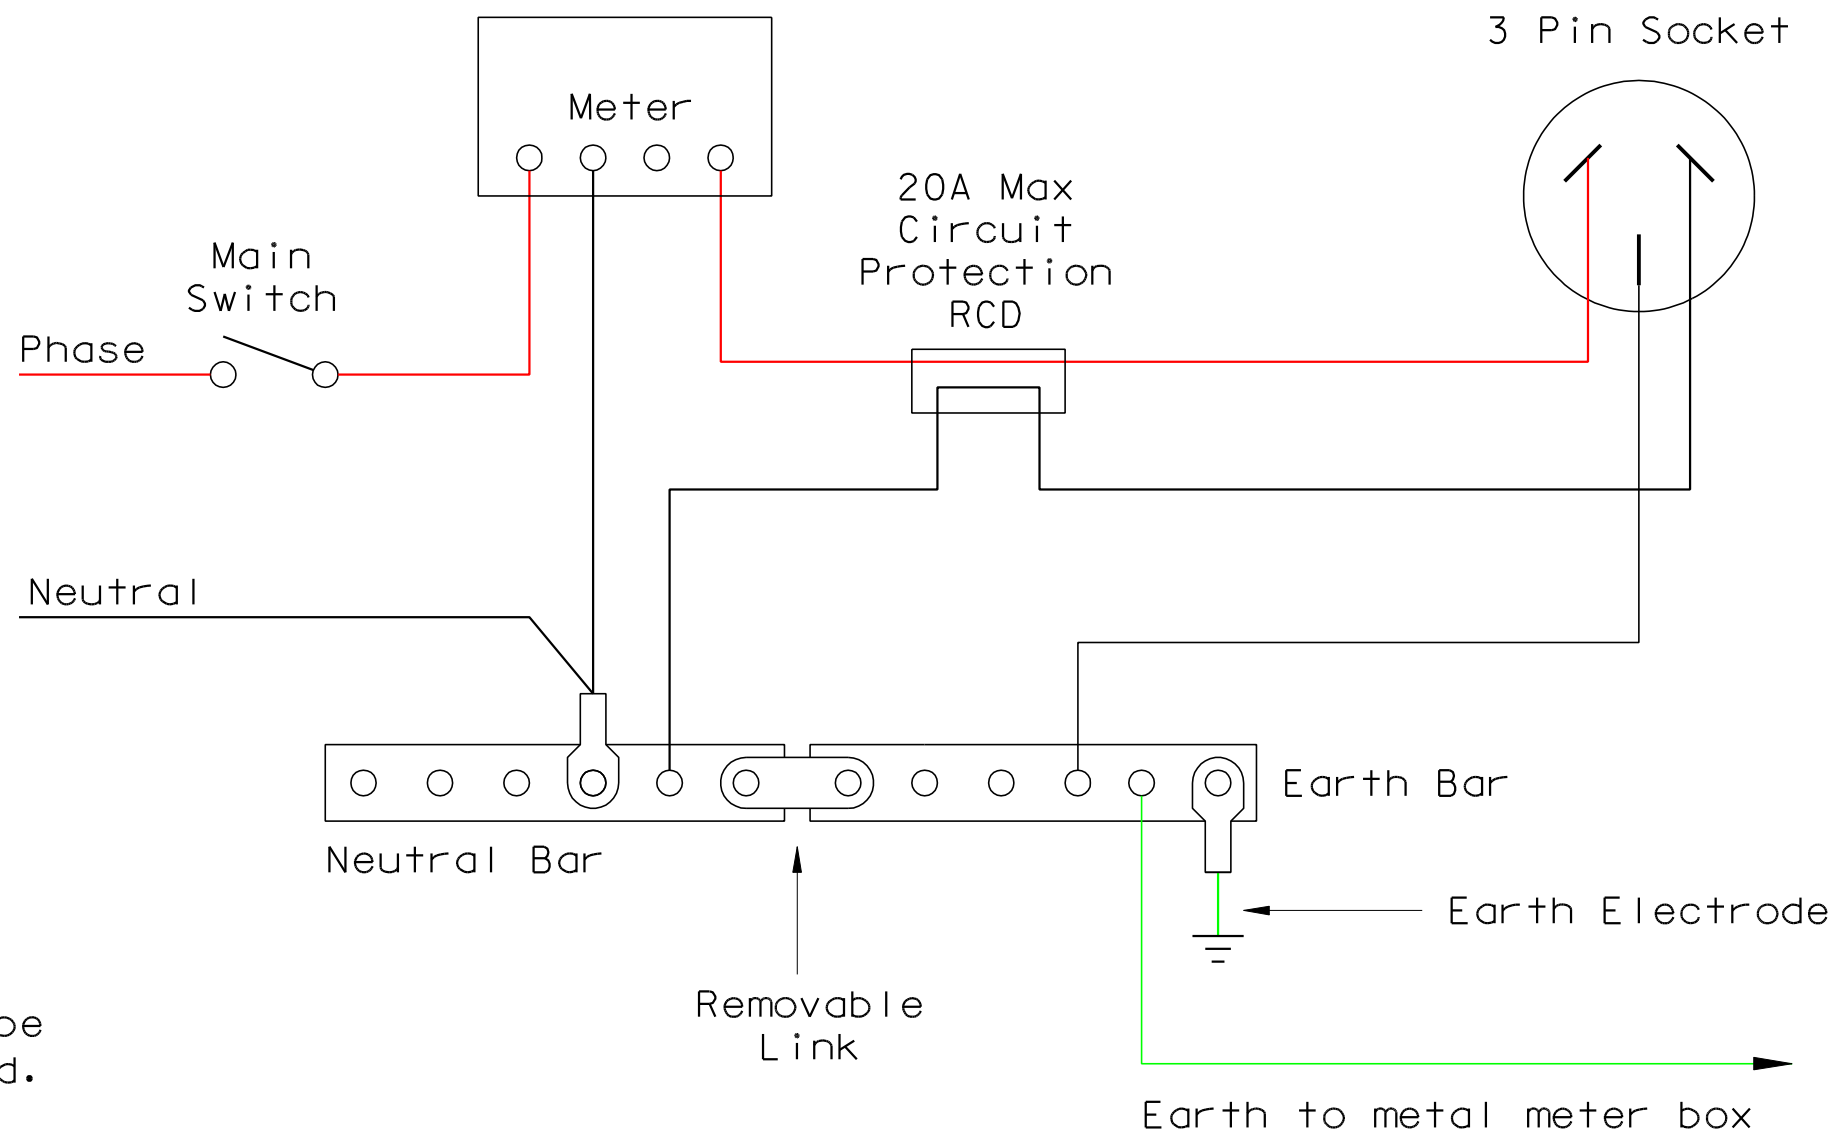

Notes.

1. All cabling to be Double Insulated.
2. N&E bar to have Touch Protection.
3. Circuit protection can be with combined MCB/RCD or separate Fuse/MCB & RCD

Rev	Amendments	By	Checked	Date
B	Remove Second Builders Supply Diagram	CP	M.G.	28/02/14

Title		Drawn	C. Parkes	Date	16/01/03
Single Phase Temporary Builders Supply		Checked	R. Watson	Date	05/07/05
		Approved	S. Lowe	Date	05/07/05
Scale NTS		Issue	B	Date	5/03/14
		Plan Number		2G228s14	
Sheet size		A4			